

New Franklin VFD

Job #40872

THIS REPORT CONTAINS PHOTOS OF:

- The truck as assembly work continues.

GLICK

FIRE EQUIPMENT COMPANY, INC.















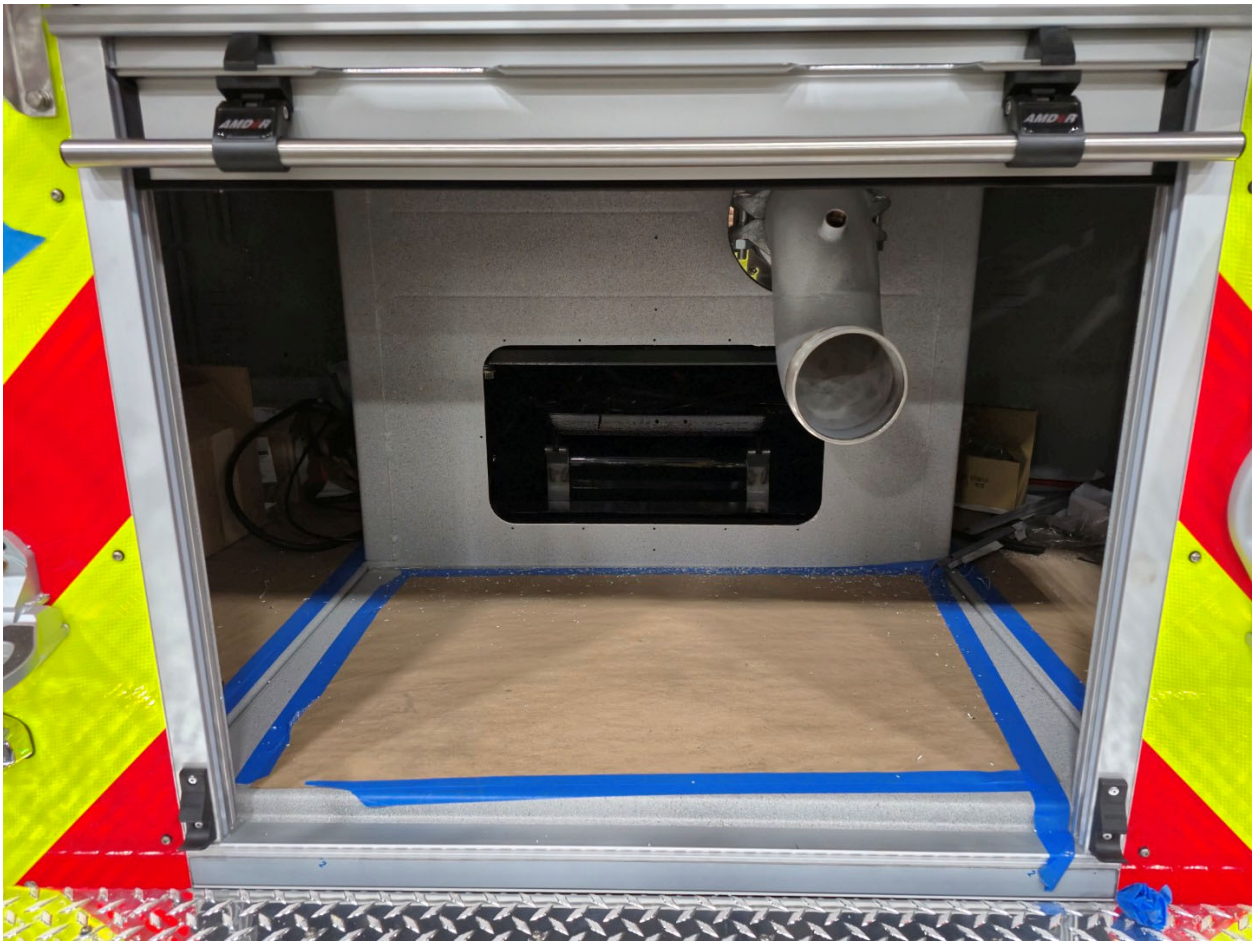

CAUTION
DIESEL EXHAUST FLUID (DEF) ONLY!
FILLING THE DEF TANK WITH OTHER LIQUIDS CAN RESULT IN PREMATURE FAILURE OF ENGINE AND EMISSIONS COMPONENTS.
DEF TANK CAPACITY: 6.0 US GALLONS

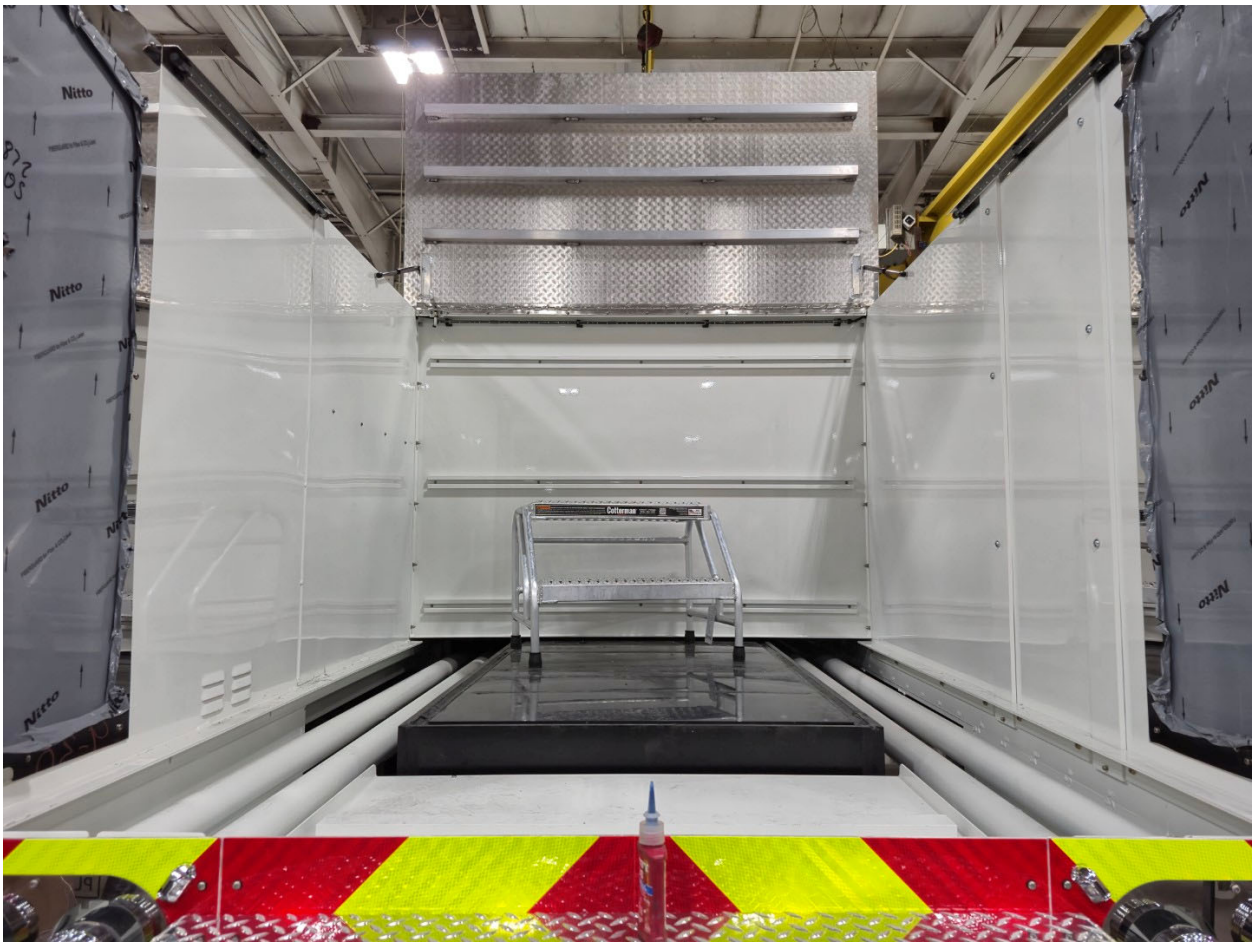

10878 #10 OK 9-14-16
10872






FINAL
ASSEMBLY
LANE 2B
STATION 4




Nitto
Nitto
Nitto
Nitto
Cotterman





