

New Franklin VFD

Job #40872

THIS REPORT CONTAINS PHOTOS OF:

- The truck as it gets closer to final inspection.

GLICK


FIRE EQUIPMENT COMPANY, INC.









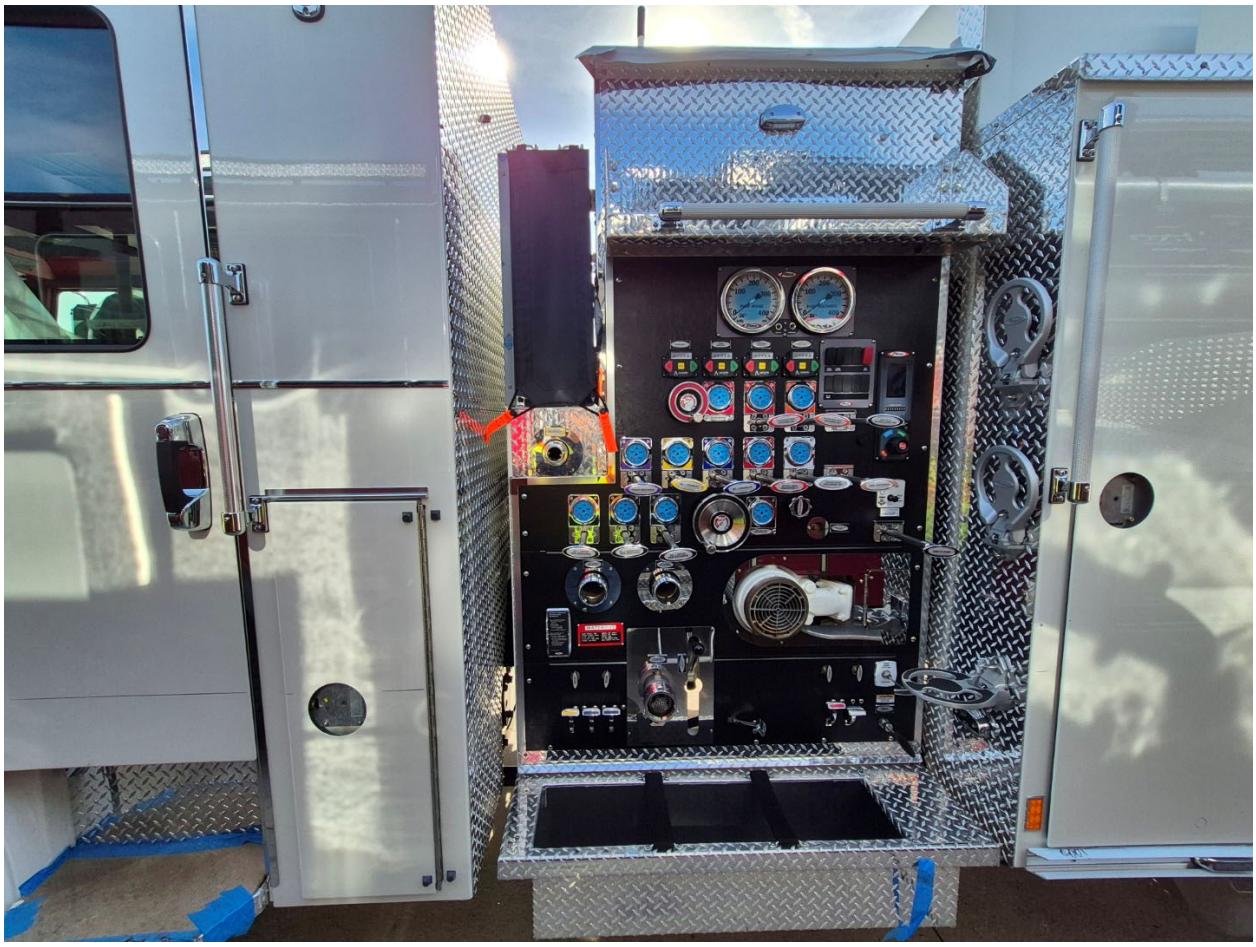



















CAUTION
DIESEL EXHAUST FLUID (DEF) ONLY!
FILLING THE DEF TANK WITH OTHER LIQUIDS CAN RESULT IN PREMATURE FAILURE OF ENGINE AND EMISSIONS COMPONENTS.
DEF TANK CAPACITY: 6.0 US GALLONS

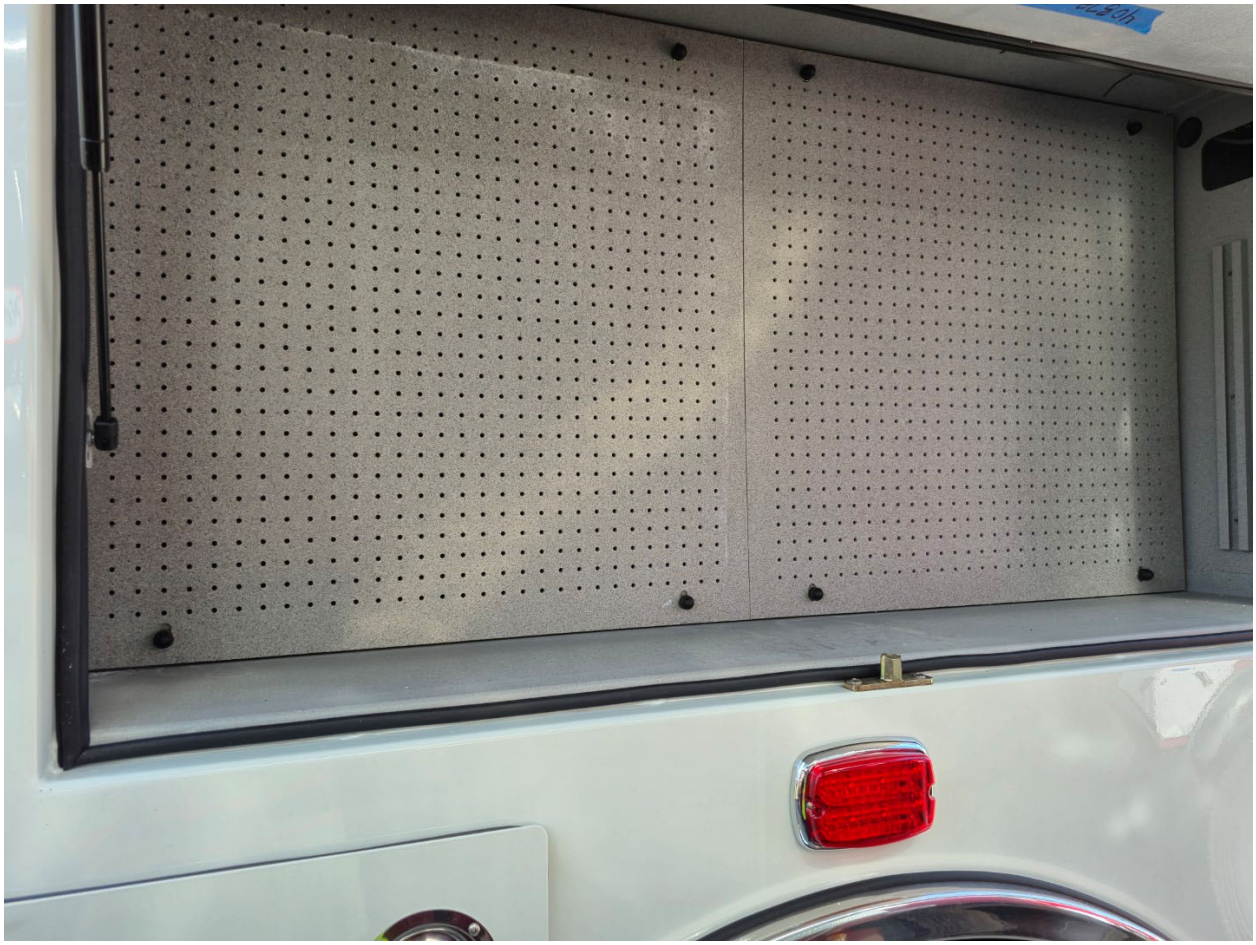




































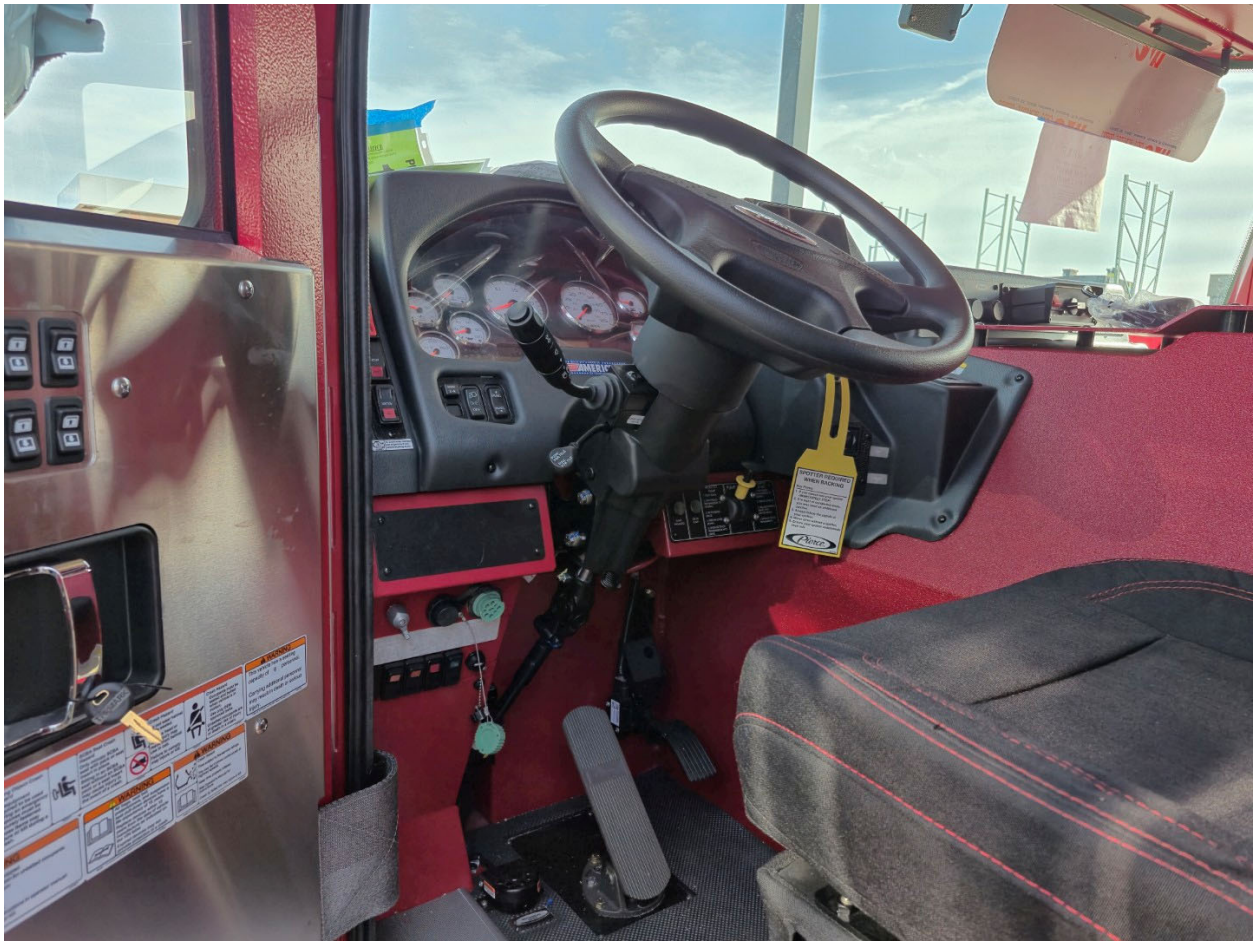


SPOTTER REQUIRED
WHEN BACKING














SRS




SRS



