

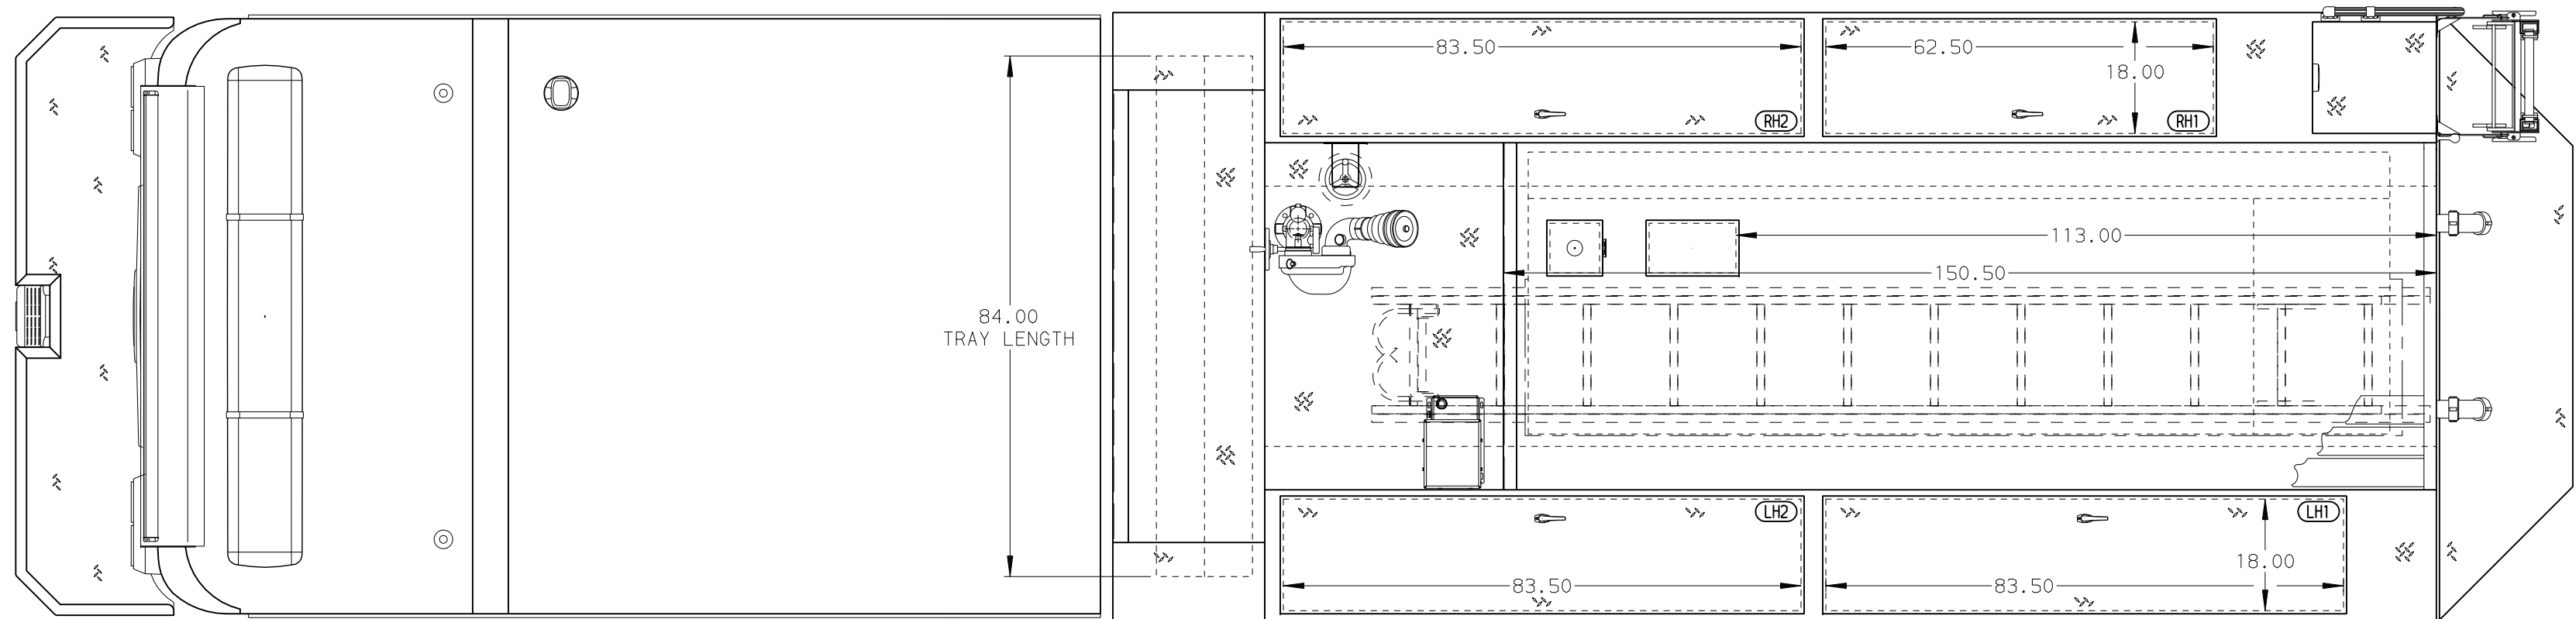
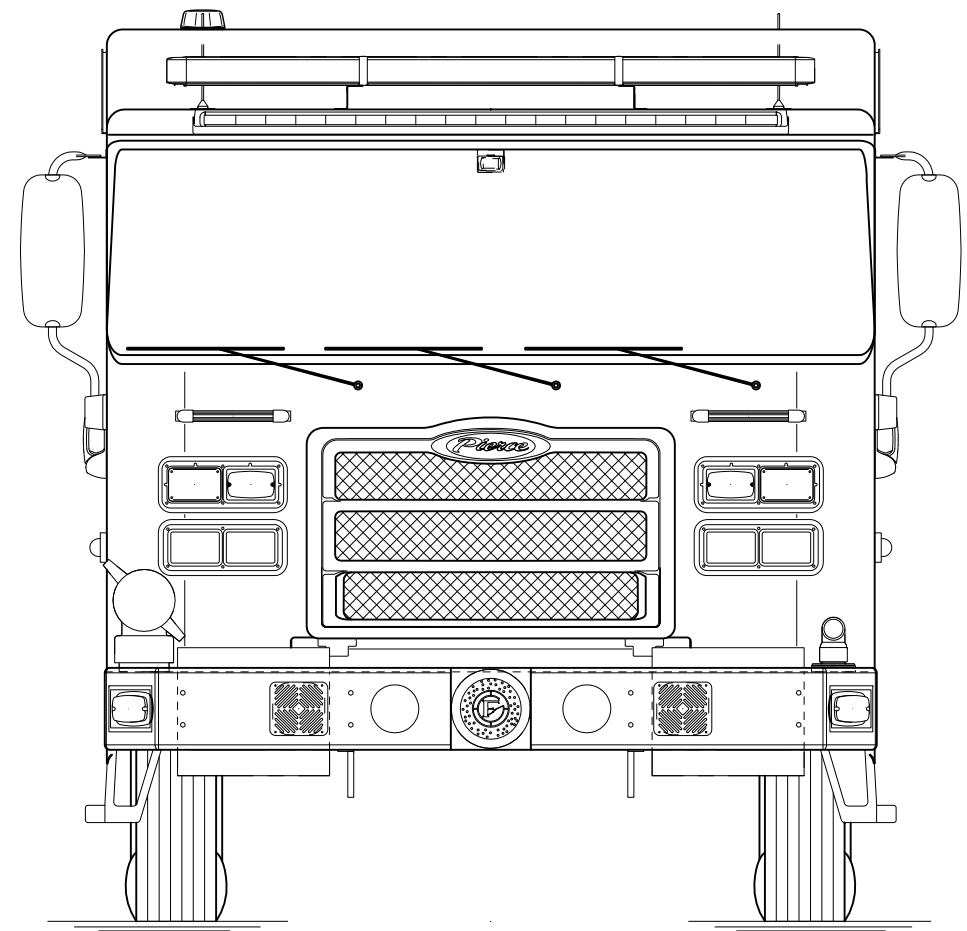
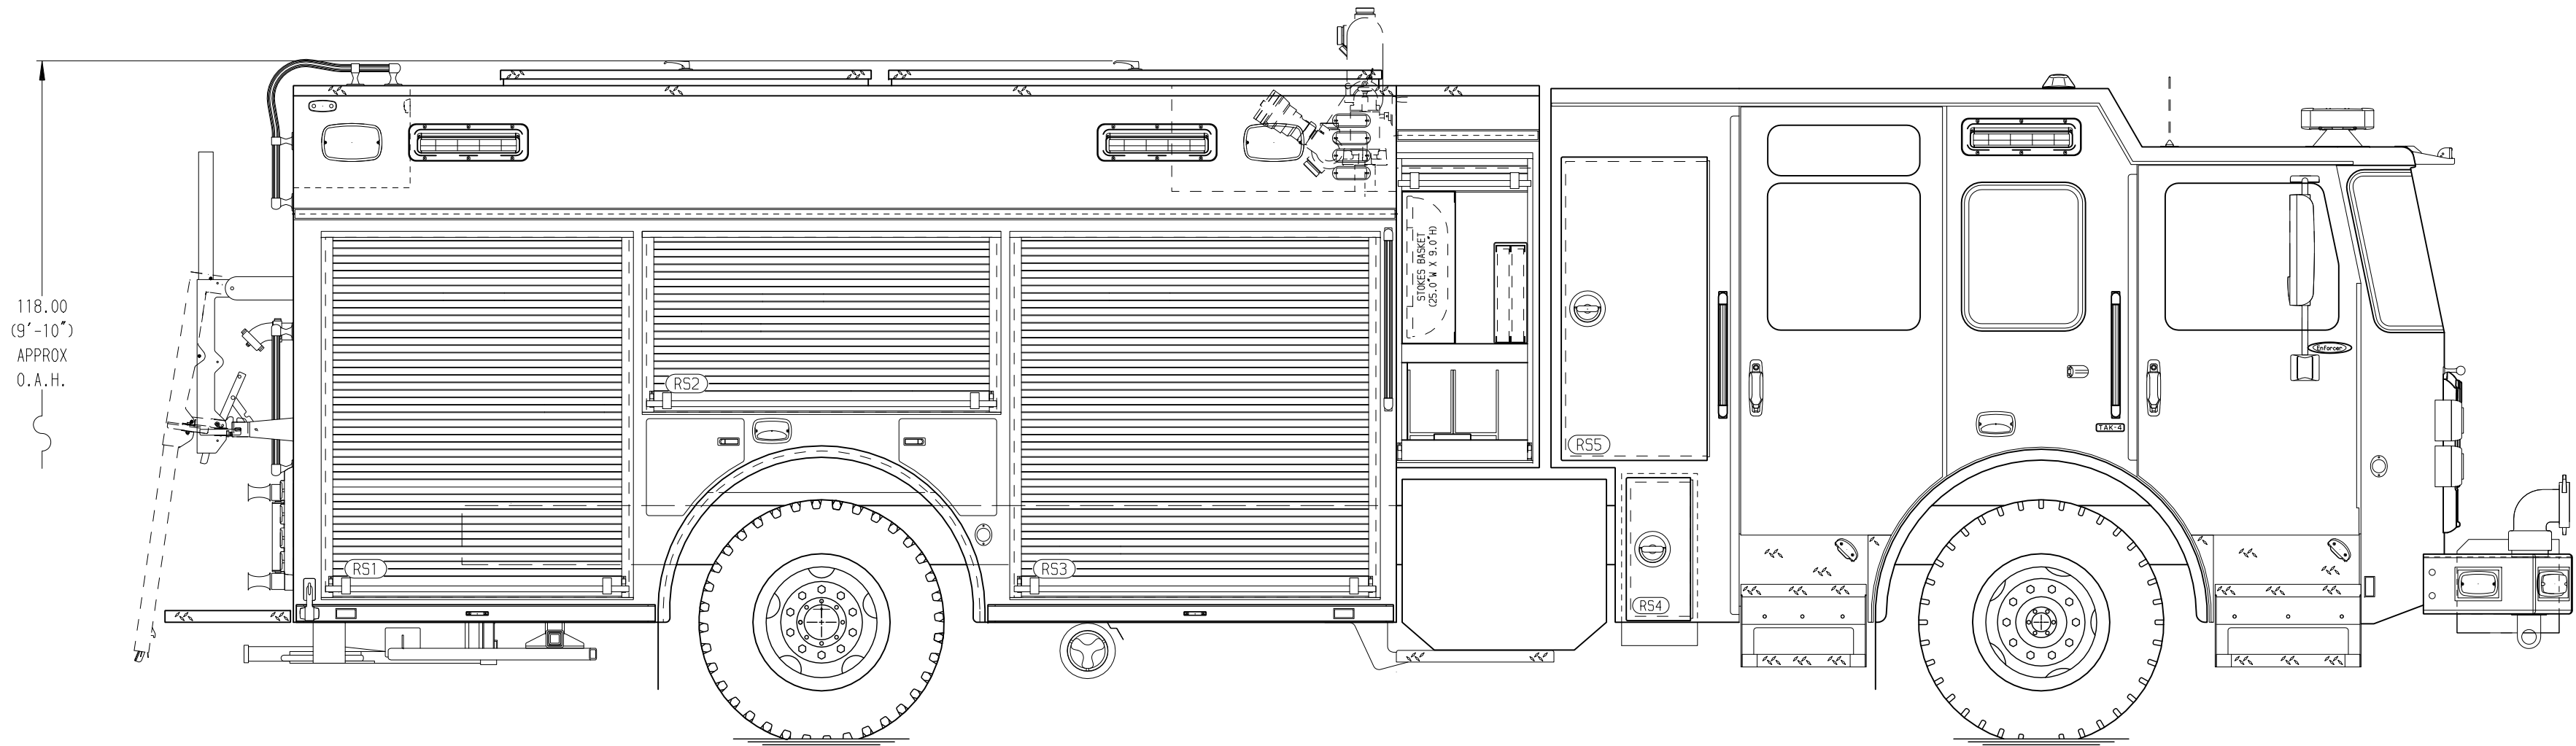


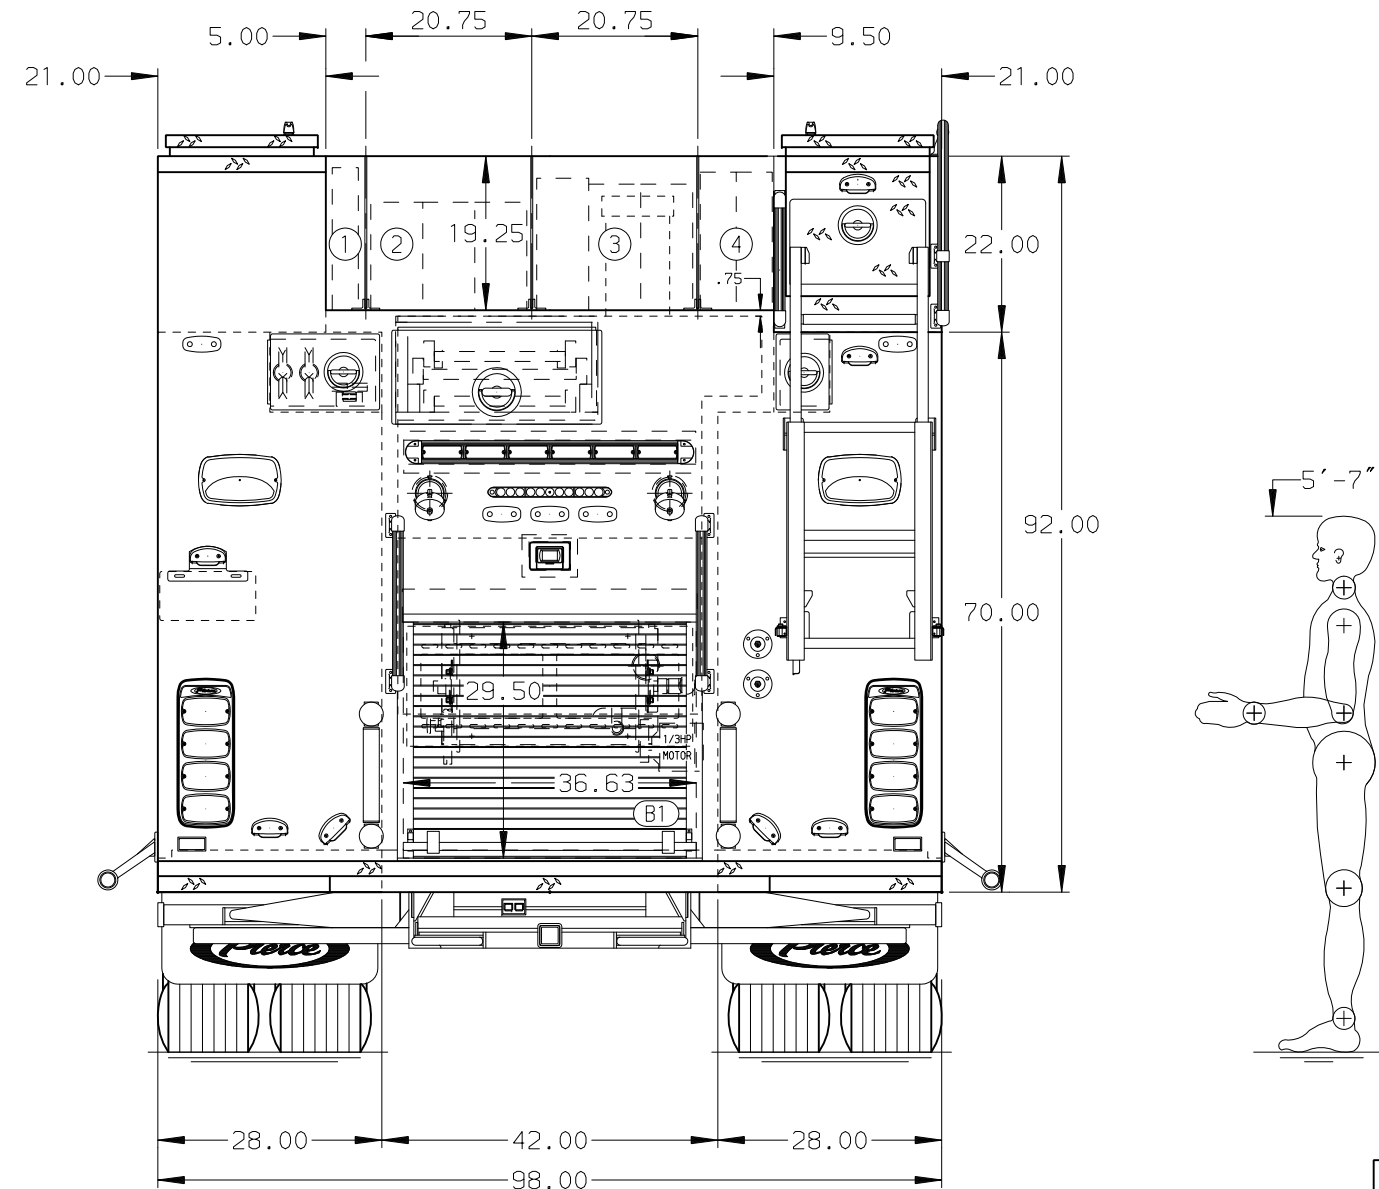

- HOSEBED CAPACITIES
- 300' OF 1.75" D.J. POLY HOSE
 - 600' OF 4.00" D.J. POLY HOSE
 - 600' OF 4.00" D.J. POLY HOSE
 - 500' OF 2.50" D.J. POLY HOSE

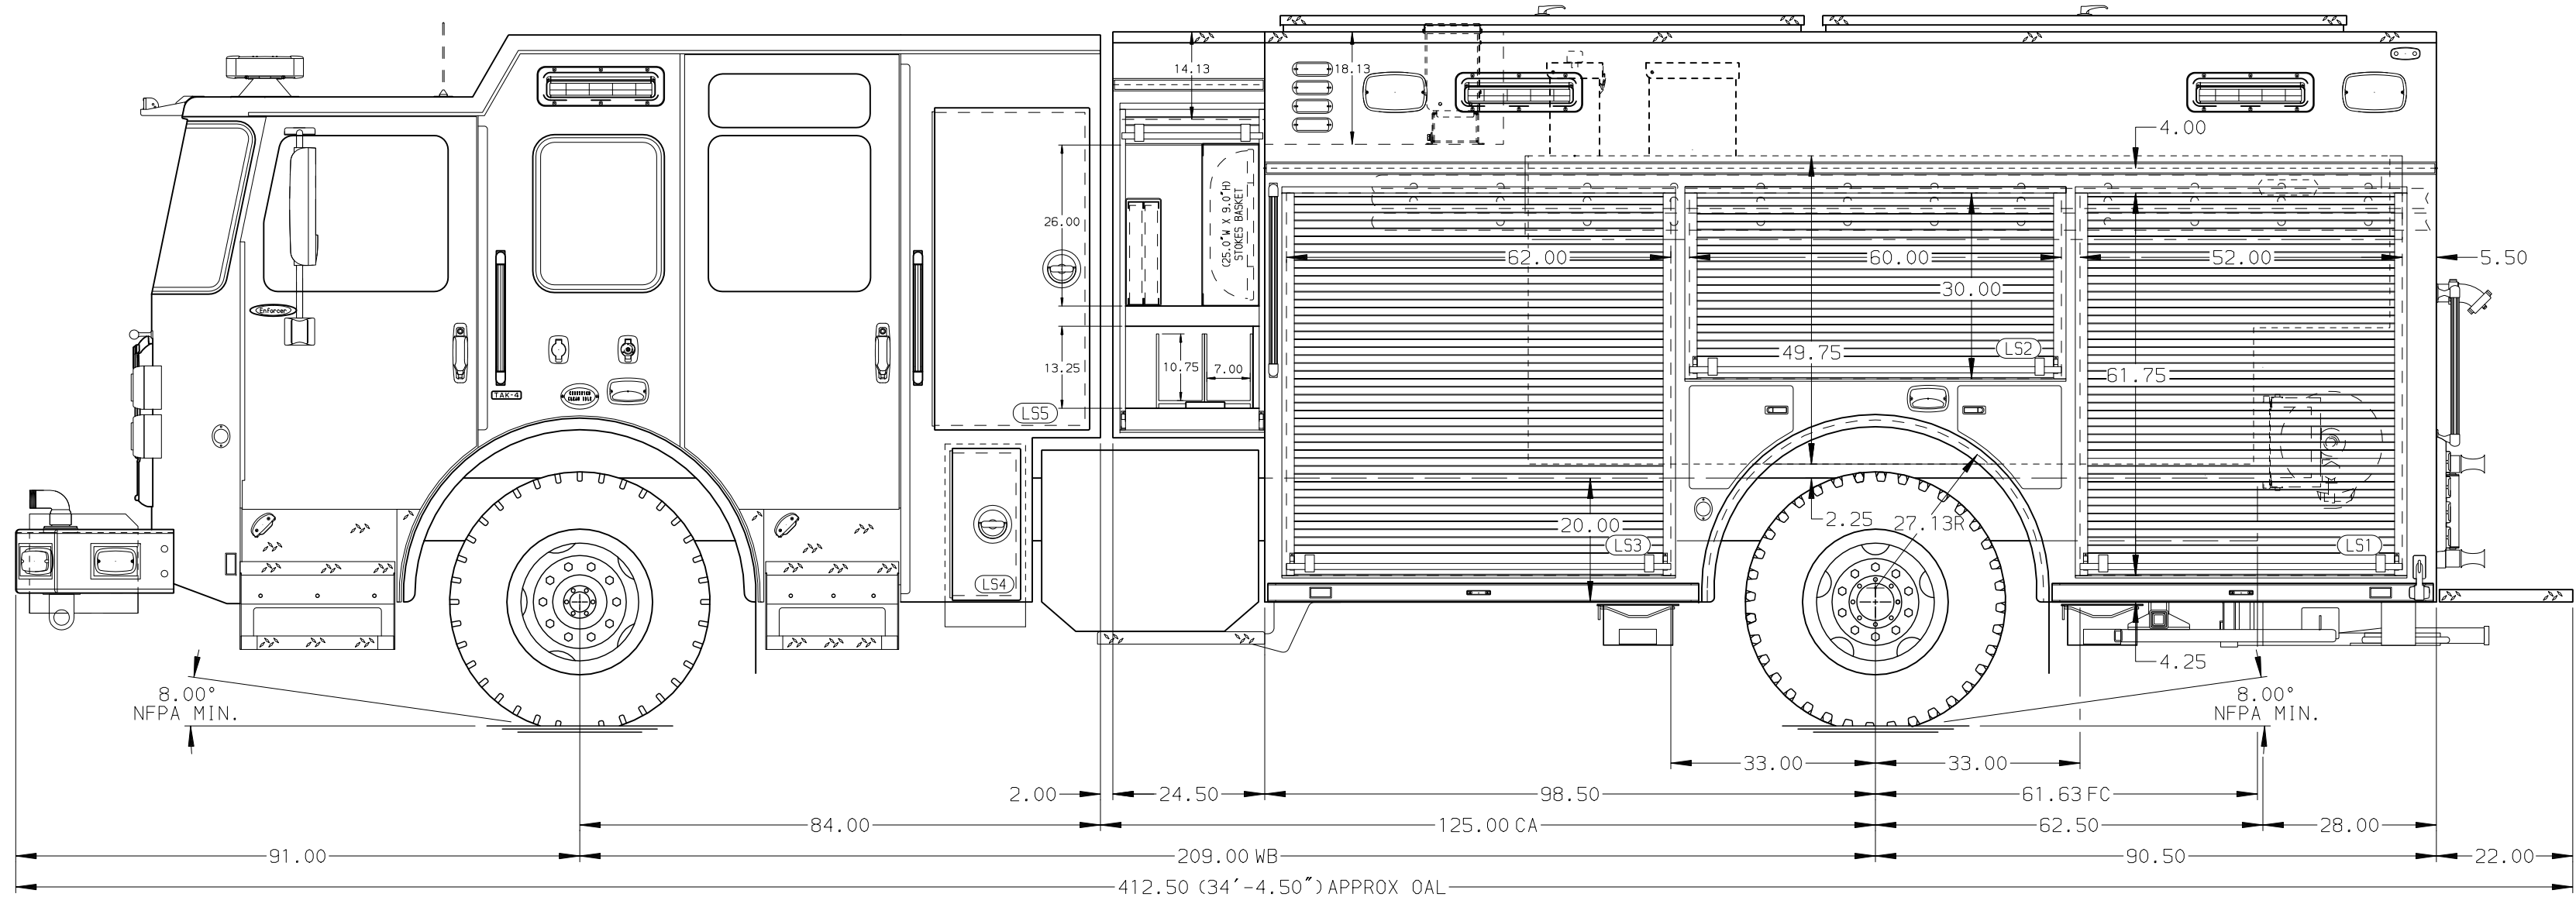

ALUMINUM BODY

MAXIMUM O.A.H. 120.00"

NOTE
DIMENSIONS SHOWN ARE APPROXIMATE
AND ARE SUBJECT TO MINOR DEVIATIONS
AS MAY OCCUR OR BE NECESSARY IN
CONSTRUCTION.
MINOR DETAILS NOT SHOWN.

CUSTOMER APPROVAL

APPROVED BY: _____
DATE: _____

				CHASSIS DATA
				MAKE
				PIERCE
				MODEL
REV	DATE	BY	CH	ENFORCER



MANUFACTURING INC.

TITLE	1500 GPM, 750G TANK, 725G WATER, 25G FOAM 189" PUC, MUX
FOR	ERIE FIRE DEPARTMENT GLICK FIRE EQUIPMENT CO, INC
DWG NO.	73027

NFPA 1900
(2024)
COMPLIANT

JOB NO.	PRELIM
SCALE	1:24
DATE	
DRAWN BY	JDA
CHECKED BY	NPA
SHEET SIZE	D
SHEET NO.	1 OF 1